

Controlled Companies of
AMERICAN DISTRICT TELEGRAPH CO.

155 SIXTH AVENUE • NEW YORK 13, N. Y.




**CENTRAL STATION PROTECTION SERVICES
IN ALL PRINCIPAL CITIES OF THE U. S.**

Form 940-N 40M-4-46

ADT
Performance
1945

**BURGLAR ALARM
and
HOLDUP ALARM
SERVICES**

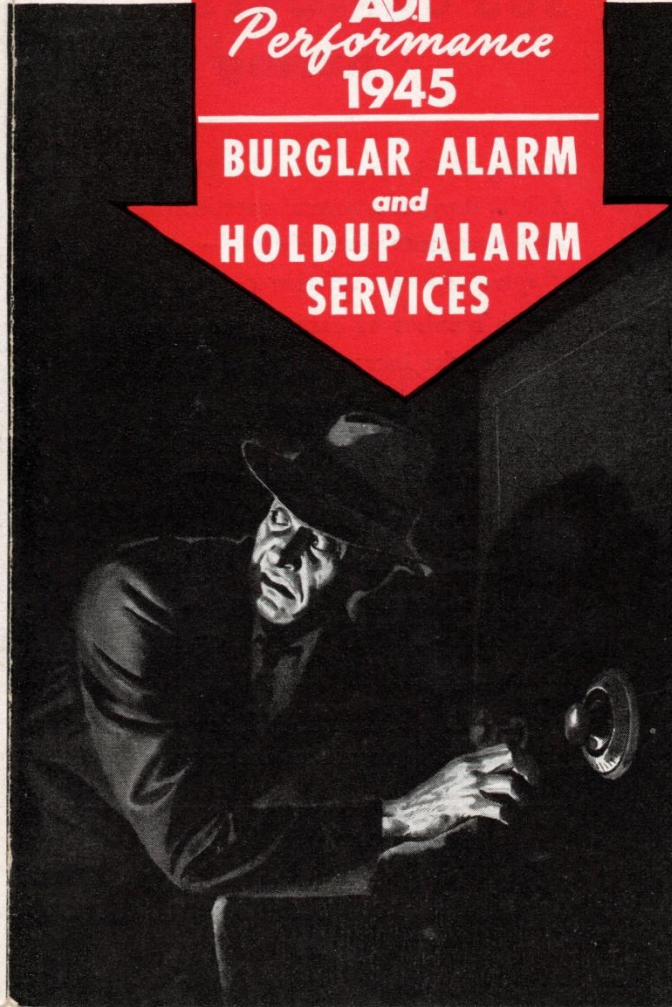

563 CAPTURES during 1945

During 1945, there were **1,528** attacks on A.D.T. Burglar Alarm Protection in which **798** entrances were effected — *an increase of approximately 50% over the previous year.*

The number of captures resulting from such attacks increased from **313** in 1944 to **509** in 1945 — *an increase of 63%.*

Captures resulting from holdup alarms increased from **15** in 1944 to **54** in 1945 — *an increase of 260%.*

In addition, there were **159** alarms caused by firemen forcing entry in performance of their duties, and **324** alarms caused by policemen and others trying unlocked doors.

The value of A.D.T. in preventing burglary losses is shown on the opposite page.

99⁹⁹/₁₀₀% IMMUNITY from BURGLARY LOSS

As desirable as the capture of criminals may be, the primary purpose of A.D.T. protection is to prevent losses. The exceptional performance of A.D.T. Burglar Alarm Service in this function is shown by the following figures for 1945:

Total insurable values* protected by A.D.T. Burglar Alarm Service: **\$1,689,925,000.**

Ratio of losses in attacks on A.D.T. Protection to insurable values attacked
1/10th of 1%.

Ratio of losses in attacks on A.D.T. Protection to insurable values protected
1/100th of 1%.

Immunity from Burglary Loss
99 99/100ths %.

*Not including the A. D. T. — protected values in bank vaults, the U. S. Treasury, 32 Federal Reserve Banks and branches, the U. S. Mints or the Bullion Depositories at Fort Knox and West Point.

A Nation-wide Protection Service against **FIRE · BURGLARY · HOLDUP** 