



Controlled Companies of
AMERICAN DISTRICT TELEGRAPH CO.
155 SIXTH AVENUE • NEW YORK 13, N. Y.

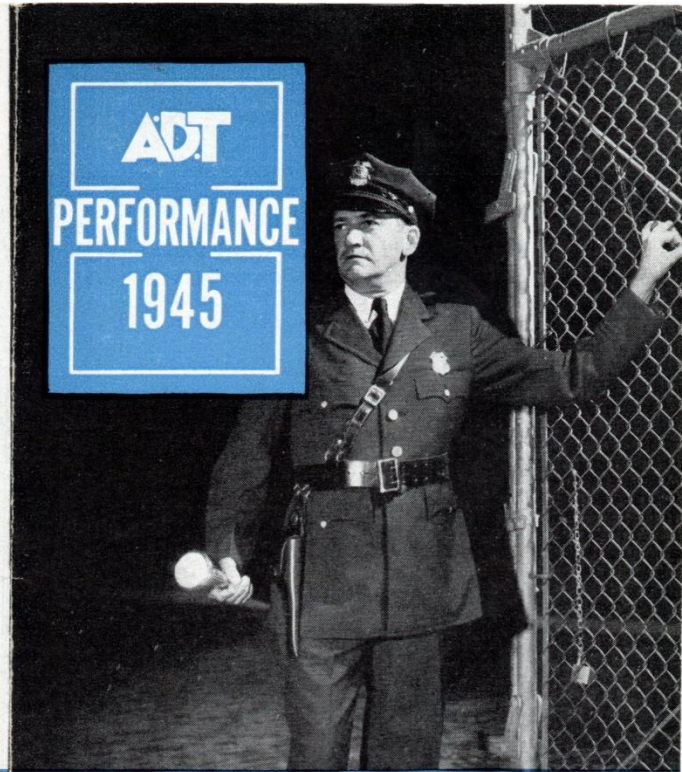

**CENTRAL STATION PROTECTION SERVICES
IN ALL PRINCIPAL CITIES OF THE U. S.**

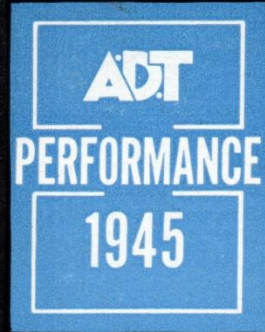

**WATCHMAN'S REPORTING *and*
MANUAL FIRE ALARM SERVICE**

PATROL EFFICIENCY

99⁹³/₁₀₀ % in 1945

During 1945, A. D. T. Central Stations investigated **241,842** failures of watchmen to signal on time, as shown below. These represent only **7/100ths of 1%** of the total of **324,893,005** signals recorded, or a patrol efficiency of **99 93/100ths %**.

Sick or otherwise disabled	3,279
Watchman missing	2,279
Forgot to signal or overlooked time . . .	56,570
Asleep	4,766
Intoxicated	314
Gone home	3,433
Late reporting for duty	2,977
Watching suspicious persons	452
Busy with other duties	55,304
Ordered not to turn in signal	5,086
Building locked, could not get in	1,017
Denied failure	28,386
Refused to state reason	21,549
Access to station obstructed	5,203
Weather prevented	2,298
Watch slow or stopped	5,389
Plant in operation	14,776
Did not know location of boxes	4,202
Miscellaneous	24,562
TOTAL	241,842

FIRE LOSS IMMUNITY

99⁹⁷/₁₀₀ %

A. D. T. Central Station Watchman's Reporting and Manual Fire Alarm Service, by maintaining a continuous check on watchmen's patrols, promptly investigating failures to signal at scheduled times and furnishing immediate assistance in emergencies, assures maximum effectiveness of watchmen's performance.

The value of this service, including its complementary private manual fire alarm service, in safeguarding against the hazard of fire is attested by the year-to-year record of fire loss immunity in properties so protected.

During 1945, in properties protected by this service, the ratio of fire losses to insurable values was **3/100ths of 1%**.

During the past ten years, the average fire loss ratio has been **3/100ths of 1%** — a fire loss immunity of **99 97/100ths %**.

A Nation-wide Protection Service against **FIRE · BURGLARY · HOLDUP** 